


Hus B

D 150 ab
vg +23,73

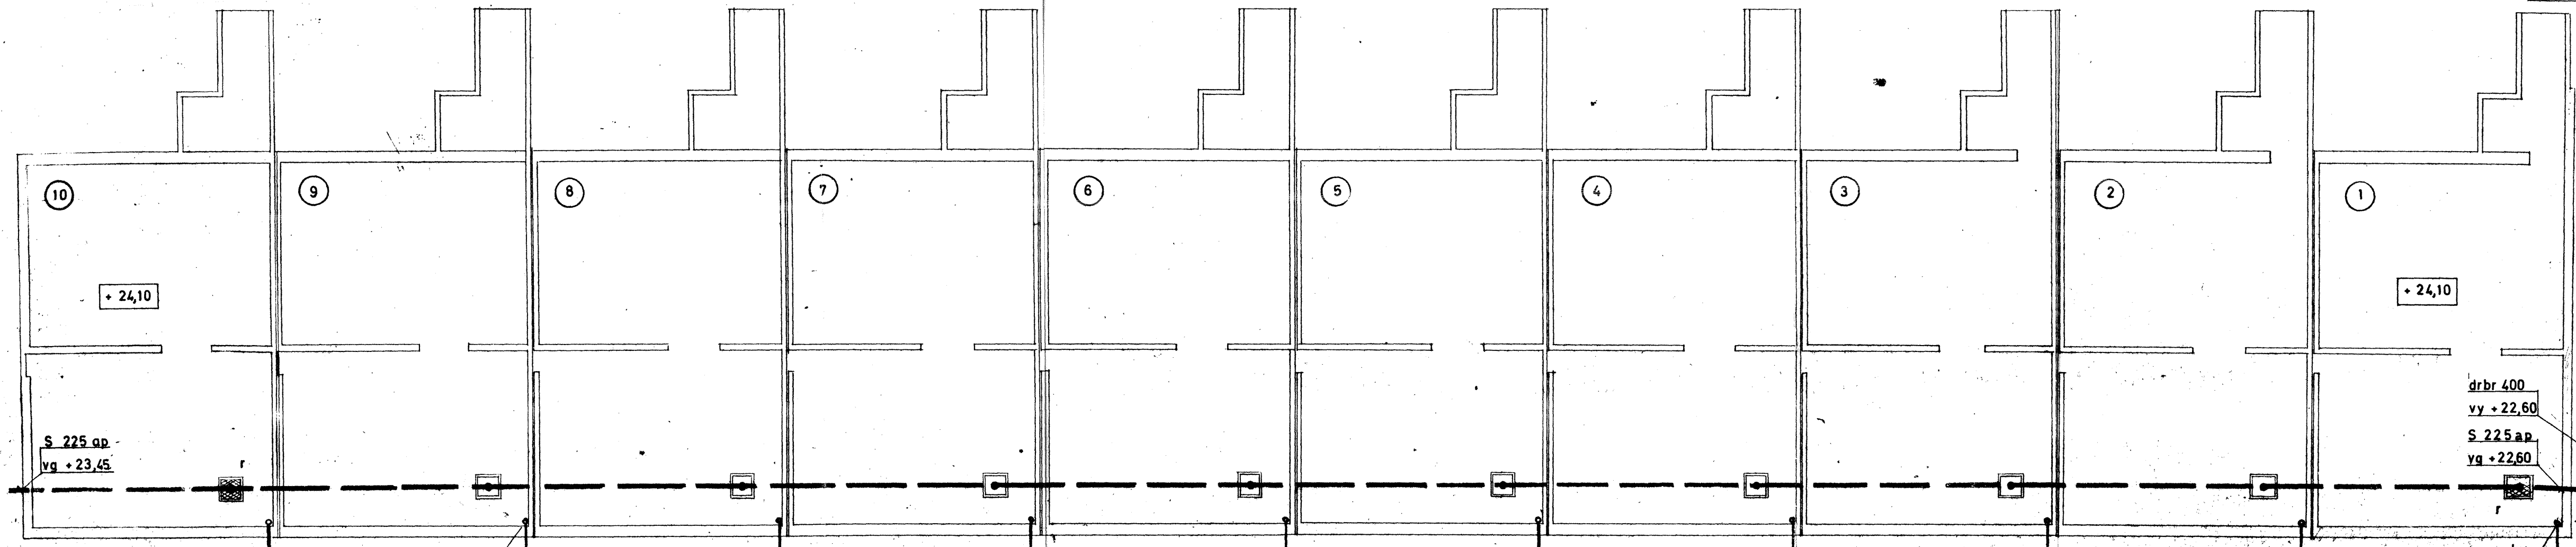

S 225 ap
vg +23,45

+24,10

drbr 400
vy +22,60
S 225 ap
yg +22,60

ansl
S 225 ap
vg +22,55
Ba 900
vg +23,40

D 150 ab
vg +24,45
80 kv
nbr 900

+25,35

kv
39
stpr
100
39 kv
v 80 kv
v 40 kv

kv
39
stpr
100
39 kv
v 40 kv

ansl
D 225 ab
vg +23,30

ansl
80 kv

+25,45

vattenmät.
brunn ø 1500